



Most Widely Accepted and Trusted

# ICC-ES Report

ICC-ES | (800) 423-6587 | (562) 699-0543 | www.icc-es.org

# ESR-1746

Reissued 11/2016  
This report is subject to renewal 11/2018.

**DIVISION: 03 00 00—CONCRETE**

**SECTION: 03 16 00—CONCRETE ANCHORS**

**SECTION: 03 41 00—PRECAST STRUCTURAL CONCRETE**

**SECTION: 03 47 00—SITE-CAST CONCRETE**

**REPORT HOLDER:**

**COMPOSITE TECHNOLOGIES, LLC dba THERMOMASS**

**1000 TECHNOLOGY DRIVE  
POST OFFICE BOX 950  
BOONE, IOWA 50036**

**EVALUATION SUBJECT:**

**THERMOMASS® MC AND MS FIBER REINFORCED COMPOSITE WYTHE  
CONNECTORS FOR INTEGRALLY INSULATED WALL PANELS**



Look for the trusted marks of Conformity!

*“2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence”*



A Subsidiary of  **INTERNATIONAL CODE COUNCIL™**

*ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.*



# ICC-ES Evaluation Report

**ESR-1746**

Reissued November 2016

Corrected February 8, 2017

This report is subject to renewal November 2018.

[www.icc-es.org](http://www.icc-es.org) | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

## DIVISION: 03 00 00—CONCRETE

Section: 03 16 00—Concrete Anchors

Section: 03 41 00—Precast Structural Concrete

Section: 03 47 00—Site-Cast Concrete

## REPORT HOLDER:

COMPOSITE TECHNOLOGIES, LLC dba THERMOMASS

1000 TECHNOLOGY DRIVE

POST OFFICE BOX 950

BOONE, IOWA 50036

(515) 433-6075

[www.thermomass.com](http://www.thermomass.com)

[vseshappa@thermomass.com](mailto:vseshappa@thermomass.com)

[bnesset@thermomass.com](mailto:bnesset@thermomass.com)

## EVALUATION SUBJECT:

THERMOMASS® MC AND MS FIBER REINFORCED  
COMPOSITE WYTHE CONNECTORS FOR INTEGRALLY  
INSULATED WALL PANELS

## 1.0 EVALUATION SCOPE

### Compliance with the following codes:

- 2015, 2012 and 2009 *International Building Code*® (IBC)
- 2013 *Abu Dhabi International Building Code* (ADIBC)<sup>†</sup>

<sup>†</sup>The ADIBC is based on the 2009 IBC. 2009 IBC code sections referenced in this report are the same sections in the ADIBC.

- 1997 *Uniform Building Code*™ (UBC)

### Properties evaluated:

- Structural
- Environmental
- Physical and mechanical

## 2.0 USES

The MC and MS connectors are used in integrally insulated concrete walls (commonly known as sandwich walls) to resist static and transient tension and shear loads in uncracked, normal-weight concrete. The connectors are alternatives to cast-in-place steel anchors described in Section 1901.3 of the 2015 IBC, Sections 1908 and 1909 of the 2012 IBC, Sections 1911 and 1912 of the 2009 IBC, and Section 1923 of the UBC.

## 3.0 DESCRIPTION

### 3.1 Connectors:

MC and MS connectors are fiber-reinforced composite connectors with dove-tail anchors at both ends for anchorage into wet concrete with a plastic overmold in the middle of the connector. The connectors are illustrated in Figure 1. The connectors are produced by a pultrusion process from a polymer composite consisting of epoxy vinylester resin reinforced with glass fibers. The overmold is injection-molded from polystyrene plastic.

The MC and MS connectors measure 0.224 inch (5.7 mm) thick and 0.393 inch (10 mm) wide.

### 3.2 Concrete:

Normal-weight concrete must conform to Section 1903 of the IBC or UBC and Section 1905 of the 2009 IBC or UBC, as applicable and comply with the compressive strength requirements in Table 2.

## 4.0 DESIGN AND INSTALLATION

### 4.1 Physical and Material Properties of the Connectors:

Design must be based on the physical and mechanical properties described in Tables 1 and 2.

### 4.2 Design for Tension and Shear:

Design must be performed using the applicable sections of the applicable codes and using the allowable loads as noted in Table 2. Allowable loads for MC or MS connectors subjected to combined shear and tension forces must be determined by the following equation:

$$(P_s/P_t) + (V_s/V_t) \leq 1$$

where:

$P_s$  = Applied service tension load (lbf or N).

$P_t$  = Service tension load (lbf or N).

$V_s$  = Applied service shear load (lbf or N).

$V_t$  = Service shear load (lbf or N).

### 4.3 Displacement of the Connector:

The displacement due to gravity loads must be limited to 0.1 inch (2.54 mm). When the connector displacement exceeds the limiting value of 0.1 inch (2.54 mm) due to the gravity loads, the free end of the connector must be

supported to maintain fixity by other means. The displacement must be calculated as follows (neglecting any contribution from the insulation in the intended application):

$$\Delta_g = \frac{Q_g \cdot d_A^3}{12E_{Ab} \cdot I_A}$$

where:

$\Delta_g$  = Displacement due to gravity load (inch or mm).

$Q_g$  = Gravity load on the connector, typically the weight of the fascia layer of the tributary area for the connector (lbf or kN),  $Q_g = t \cdot a \cdot b \cdot \gamma$ , where  $t$  = thickness of the fascia layer (feet or m);  $a$  = horizontal spacing of the connector (feet or m);  $b$  = vertical spacing of the connector (feet or m);  $\gamma$  = density of concrete (lbf/ft<sup>3</sup> or kN/m<sup>3</sup>).

$$d_A = d_d + \frac{2h_v}{3} \left[ 1 - \frac{1}{1 + \frac{h_v}{d_d}} \right]$$

where:

$d_A$  = Connector bending length, a function of insulation thickness and embedment (inch or mm).

$d_d$  = Insulation thickness (inch or mm).

$h_v$  = Embedment length of the connector in the concrete.

$E_{Ab}$  = 0.95 times the flexural modulus of elasticity as given in Table 1 (psi or MPa).

$I_A$  = Moment of inertia of the connector as given in Table 1 (in<sup>4</sup> or mm<sup>4</sup>).

The deflection of the connector may be reduced by decreasing the connector spacing, but not less than 8 inches (203 mm) on center each way.

#### 4.4 Installation:

Connector orientations and locations must comply with this report and the plans and specifications approved by the code official. MC and MS connectors must be installed in accordance with the instructions provided by Composite Technologies LLC dba Thermomass. The instructions are provided with each shipment of the connectors. The minimum embedment, critical edge distance, and critical spacings must comply with Table 3 of this report.

The minimum concrete thickness must comply with the applicable code requirements or 1.5 times the connector effective embedment, whichever is greater. Within 20 minutes after the bottom layer of concrete is placed, code-complying rigid insulation board with holes sized to accept the connectors must be placed over the concrete while it is in the plastic state. The connectors, sized to match the insulation board thickness, are inserted through the holes in the insulation board into the bottom layer of concrete, until the prescribed embedment is reached. Concrete consolidation around the connectors must be conducted in accordance with the applicable code and Thermomass published instructions. The top layer of concrete is then placed over the insulation board, engaging the connectors and consolidated. Panels must cure in accordance with the applicable code.

#### 4.5 Special Inspection:

Installations must be made under special inspection in accordance with Section 1705.1.1 of the 2015 and 2012

IBC, Section 1704.15 of the 2009 IBC, or Section 1701.5.2 of the UBC. The special inspector must be on the jobsite continuously during connector installation to verify connector type, connector dimensions, and cleanliness, embedment depth, concrete type, concrete compressive strength, edge distance(s), connector spacing(s), concrete thickness, concrete consolidation and concrete curing.

## 5.0 CONDITIONS OF USE

The Thermomass MC and MS connectors described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 Connector sizes, dimensions, and installation must comply with this report and Thermomass published installation instructions. In case of a conflict between this report and other documentation, this report governs.
- 5.2 Allowable tension and shear loads must be as noted in the Table 2.
- 5.3 Calculations and details demonstrating compliance with this report must be submitted to the code official for approval. The calculations and details must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.4 Design and installation of the concrete wall panels, except as specifically noted in this report, is outside the scope of this report and must comply with the applicable code.
- 5.5 Connectors may be recognized for interior exposure, exterior exposure or damp environments.
- 5.6 Connectors must not be permitted in contact with preservative-treated and fire-retardant-treated wood.
- 5.7 Special inspection must be provided in accordance with Section 4.5 of this report.
- 5.8 Since an ICC-ES acceptance criteria for evaluating data to determine the performance of connectors subjected to fatigue or shock loading is unavailable at this time, the use of these connectors under these conditions is beyond the scope of this report.
- 5.9 Since an ICC-ES acceptance criteria for evaluating data to determine the performance of fiber-reinforced connectors in cracked concrete is unavailable at this time, the use of these connectors must be limited to installation in uncracked, normal-weight concrete. Cracking occurs when  $f_t > f_r$  due to service loads or deformations.
- 5.10 Connectors must not be permitted for use in conjunction with fire-resistance-rated construction. Exceptions are:
  - Connectors resist wind loading only.
  - For other than wind loading, special consideration is given to fire exposure conditions.
- 5.11 Seismic or wind load under the IBC: Use of the connectors to resist seismic loads is beyond the scope of this report. When using the basic load combinations in accordance with IBC Section 1605.3.1.1, allowable loads are not permitted to be increased for wind loading. When using the alternative basic load combinations in IBC Section 1605.3.2 that include wind loads, the allowable shear and tension loads for connectors may be increased.

**5.12** Seismic or wind load under the UBC: When using the basic load combinations in accordance with UBC Section 1612.3.1, allowable loads are not permitted to be increased for wind or seismic loading. When using the alternative basic load combinations in UBC Section 1612.3.2 that include wind or seismic loads, the allowable shear and tension loads for connectors are permitted to be increased by 33<sup>1</sup>/<sub>3</sub> percent.

**5.13** Connectors are manufactured by Composite Technologies, LLC dba Thermomass, under a quality control program with inspections conducted by ICC-ES.

Polymer Connectors Anchored in Concrete (AC320), dated October 2015, including seismic tests, creep tests, and extreme temperature tests.

**7.0 IDENTIFICATION**

The connectors must be identified in the field by dimensional characteristics and packaging. The packaging label indicates the Composite Technologies, LLC dba Thermomass name and address, and the ICC-ES report Number (ESR-1746). Each connector is stamped with the lot number.

**6.0 EVIDENCE SUBMITTED**

Data in accordance with the ICC-ES Acceptance Criteria for Fiber-reinforced Polymer Composite or Unreinforced

**TABLE 1—PHYSICAL AND MECHANICAL PROPERTIES**

| DESCRIPTION                                | MC CONNECTOR              |                      | MS CONNECTOR              |                      |
|--|---------------------------|----------------------|---------------------------|----------------------|
|  | Customary Units           | SI Units             | Customary Units           | SI Units             |
| Cross-sectional area                       | 0.078 in <sup>2</sup>     | 50.5 mm <sup>2</sup> | 0.078 in <sup>2</sup>     | 50.5 mm <sup>2</sup> |
| Average moment of inertia                  | 0.0005858 in <sup>4</sup> | 243 mm <sup>4</sup>  | 0.0005858 in <sup>4</sup> | 243 mm <sup>4</sup>  |
| Embedment depth                            | 2 inches                  | 51 mm                | 1.5 inches                | 38 mm                |
| Bending elastic modulus (flexural modulus) | 4,764,000 psi             | 32,846 MPa           | 4,764,000 psi             | 32,846 MPa           |

**TABLE 2—ALLOWABLE TENSION AND SHEAR VALUES IN NORMAL-WEIGHT CONCRETE<sup>1</sup> (in pounds)**

| DESCRIPTION   | MC CONNECTOR                                   |  | MS CONNECTOR                                   |
|---|--|--|--|
|   | <i>f</i> <sub>c</sub> = 6,000 psi <sup>2</sup> | <i>f</i> <sub>c</sub> = 4,000 psi <sup>2</sup> | <i>f</i> <sub>c</sub> = 6,000 psi <sup>2</sup> |
| Static tension                                      | 707  | 577  | 608  |
| Static shear, parallel to strong axis               | 197  | 126  | 148  |
| Static shear, parallel to weak axis                 | 152  | 113  | 104  |
| Seismic tension <sup>3</sup>                        | 647  | 572  | 558  |
| Seismic shear, parallel to strong axis <sup>3</sup> | 197  | 110  | 148  |
| Seismic shear, parallel to weak axis <sup>3</sup>   | 152  | 106  | 104  |
| High-temperature tension (at 150°F)                 | 707  | N/A  | 472  |
| Low-temperature tension (at -40°F)                  | 707  | N/A  | 608  |

For **SI**: 1 psi = 6.9 kPa, 1 pound = 4.45 N, t°C = 5/9(t° - 32).

<sup>1</sup>Allowable loads have been determined by applying a factor of safety of 4 to the test results.


<sup>2</sup>Concrete must achieve this compressive strength before anchors are loaded [minimum of 24 MPa is required under ADIBC Appendix L, Section 5.1.1].

<sup>3</sup>For use under the UBC only.

**TABLE 3—INSTALLATION PARAMETERS**


| DESCRIPTION            | MC CONNECTOR (inches) | MS CONNECTOR (inches)         |
|------------------------|-----------------------|-------------------------------|
| Embedment              | 2                     | 1 <sup>1</sup> / <sub>2</sub> |
| Critical edge distance | 5.25                  | 5.25                          |
| Critical spacing       | 8                     | 8                             |

For **SI**: 1 inch = 25.4 mm.

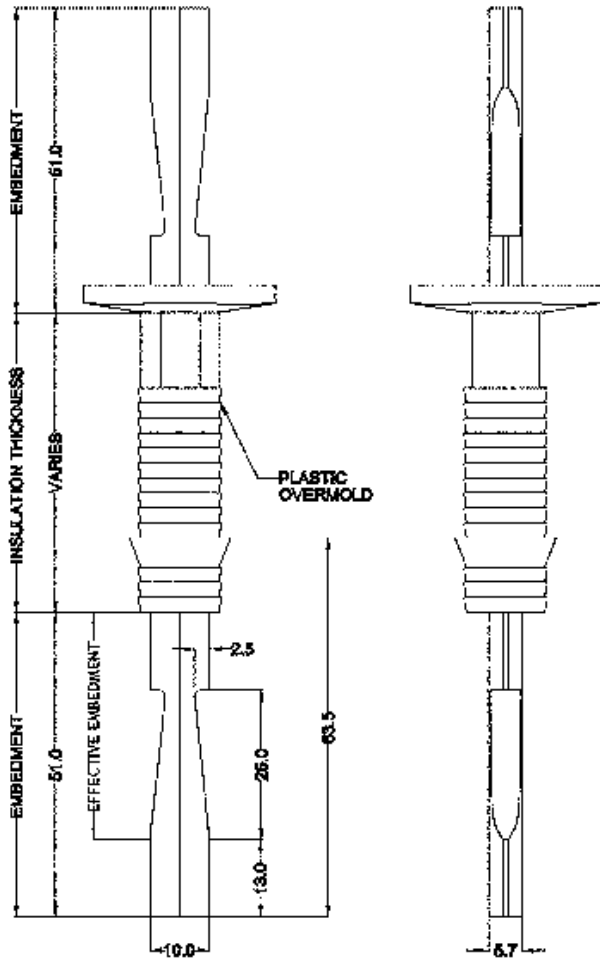

**MC CONNECTOR PROFILE**  
(ALL DIMENSIONS IN MM)

For customary units 25.4 mm = 1 inch.

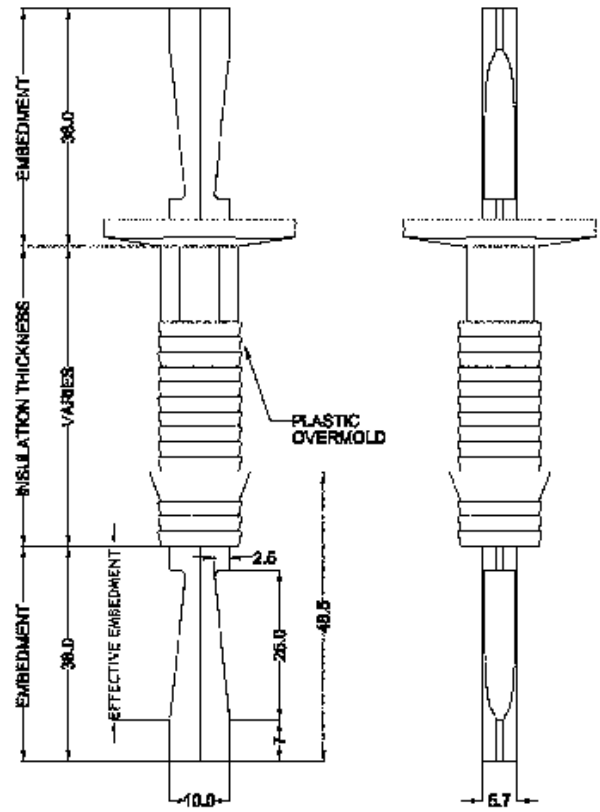

**MS CONNECTOR PROFILE**  
(ALL DIMENSIONS IN MM)

FIGURE 1